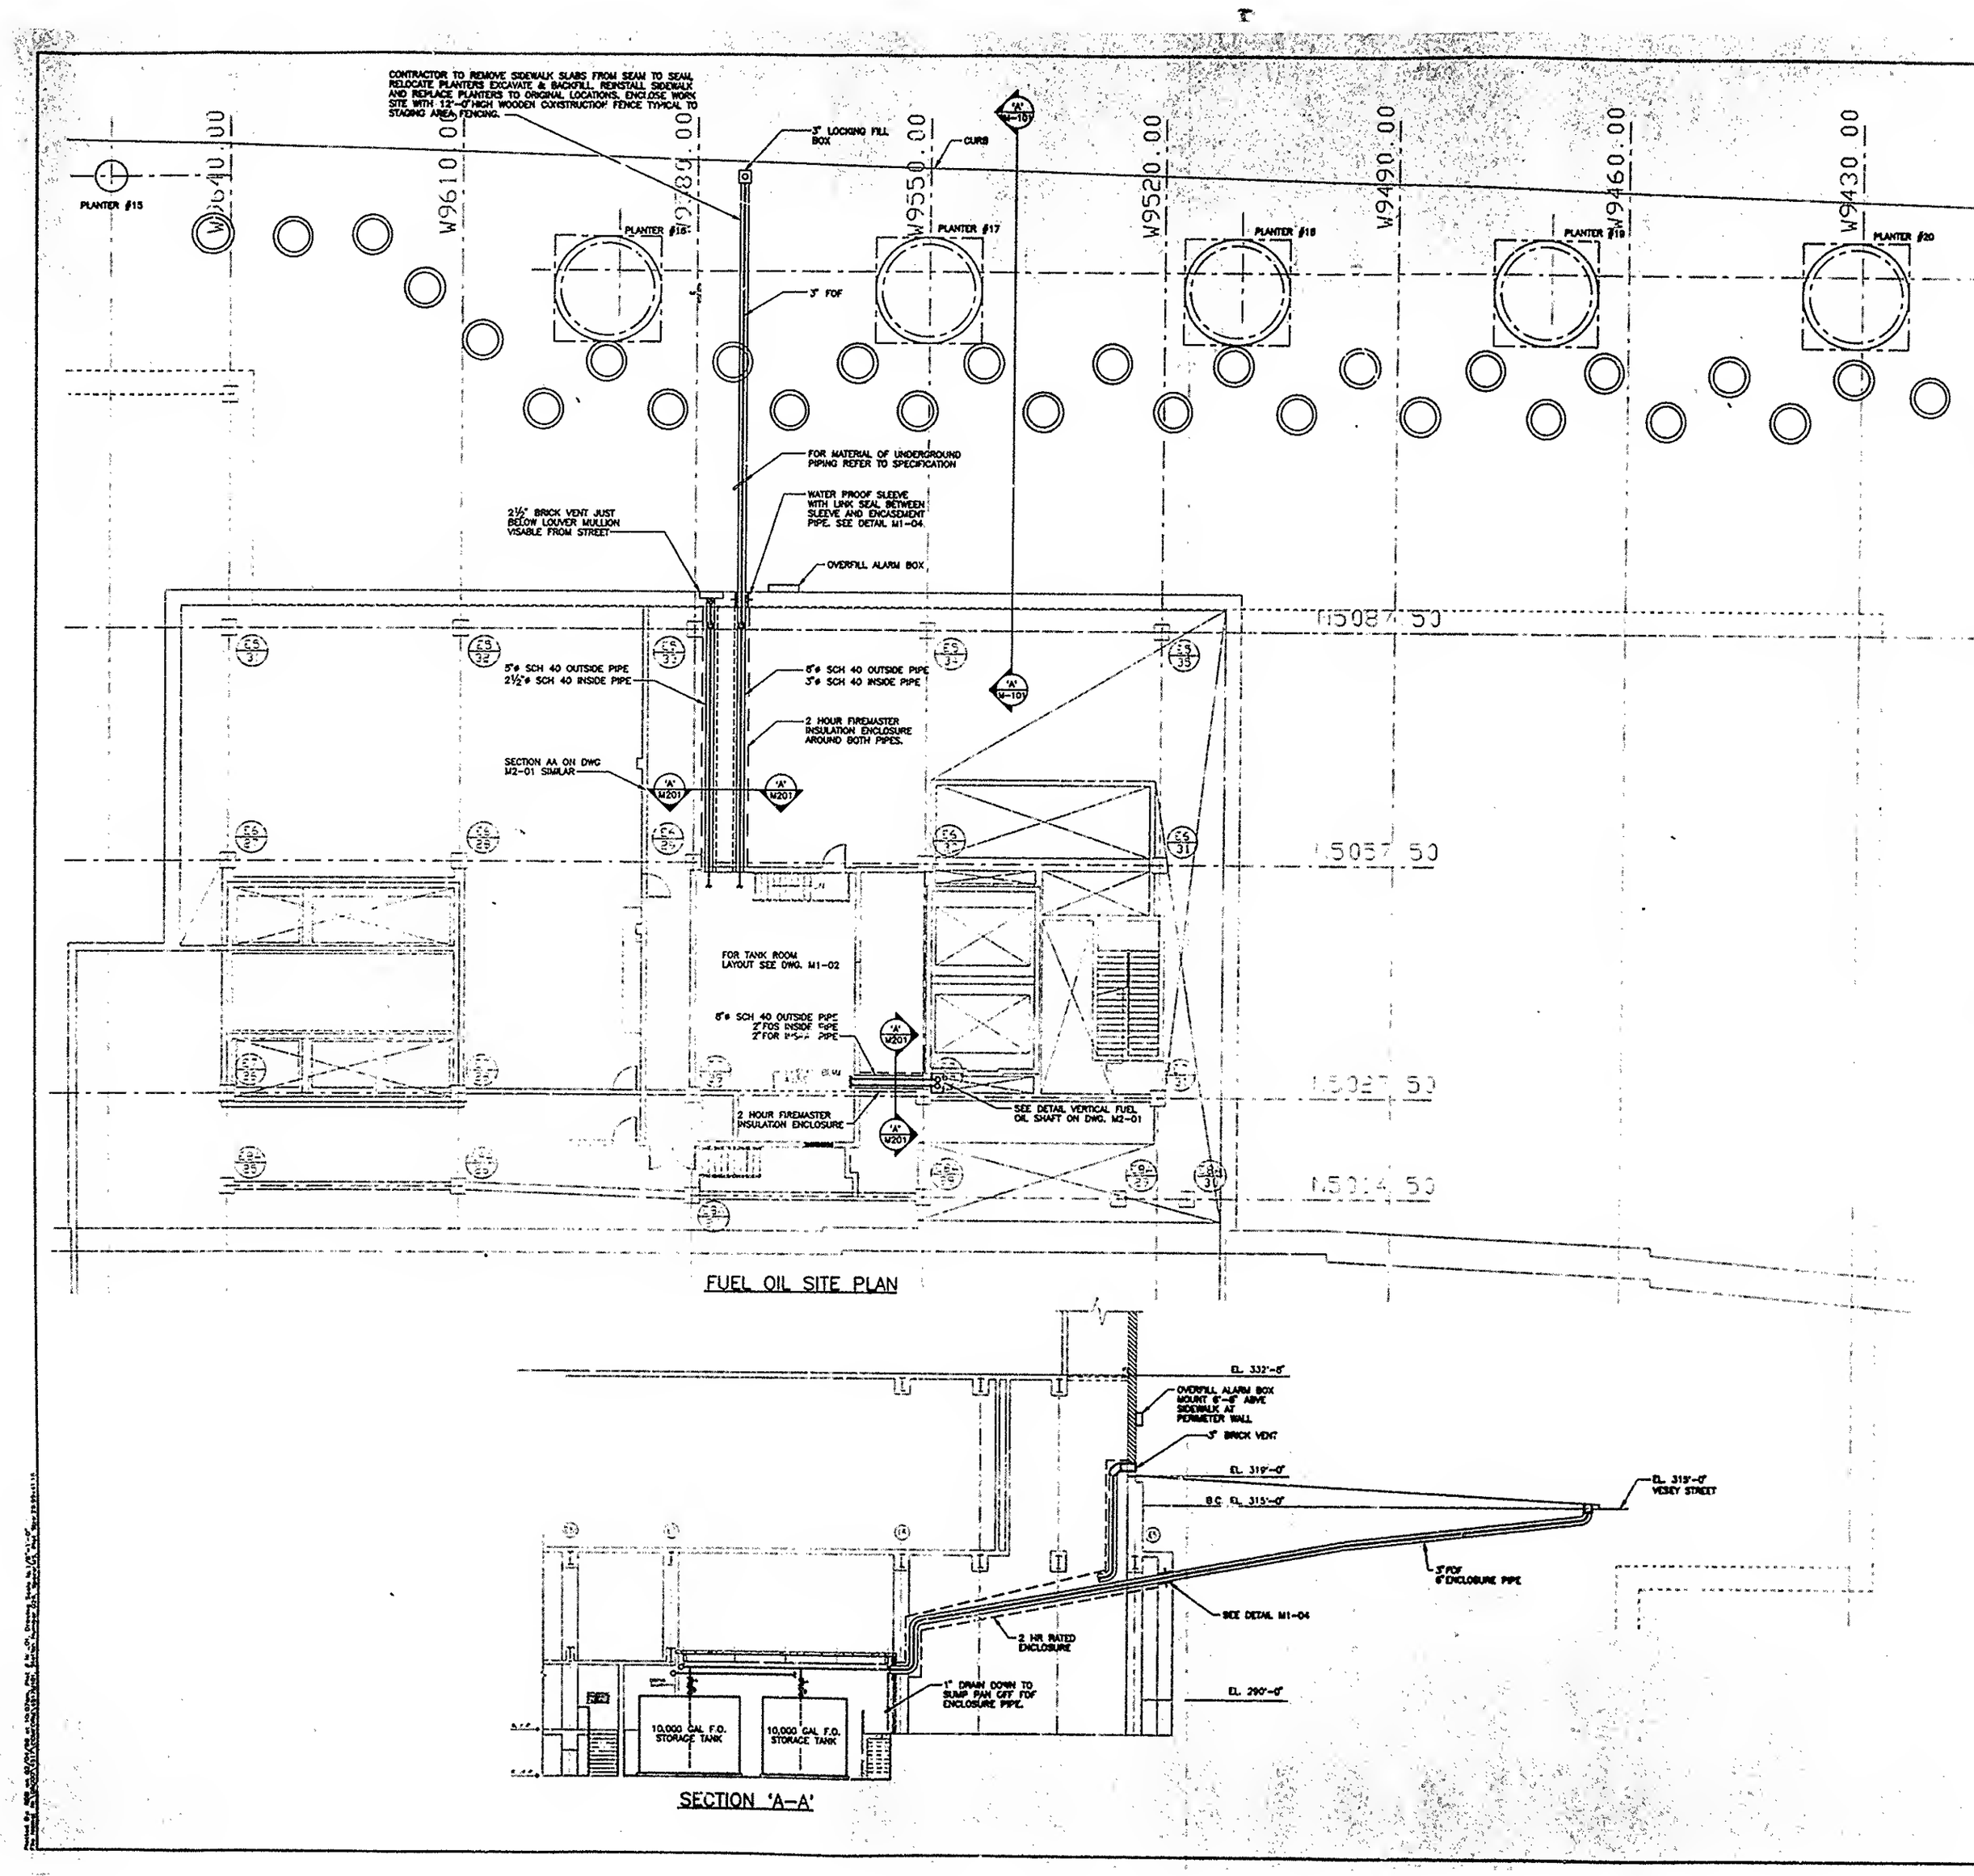
CONTRACTOR TO REMOVE SIDEWALK SLABS FROM SEAM TO SEAM, RELOCATE PLANTERS EXCAVATE & BACKFILL, REINSTALL SIDEWALK AND REPLACE PLANTERS TO ORIGINAL LOCATIONS. ENCLOSE WORK SITE WITH 12'-0" HIGH WOODEN CONSTRUCTION FENCE TYPICAL TO STAGING AREA FENCING.
3" LOCKING FILL BOX
CURB
PLANTER #15
PLANTER #16
PLANTER #17
PLANTER #18
PLANTER #19
PLANTER #20
W9640.00
W9610.00
W9580.00
W9550.00
W9520.00
W9490.00
W9460.00
W9430.00
3" FOF
FOR MATERIAL OF UNDERGROUND PIPING REFER TO SPECIFICATION
WATER PROOF SLEEVE WITH LINK SEAL BETWEEN SLEEVE AND ENCASEMENT PIPE. SEE DETAIL M1-04
OVERFILL ALARM BOX
2½" BRICK VENT JUST BELOW LOUVER MULLION VISABLE FROM STREET
5"ø SCH 40 OUTSIDE PIPE
2½"ø SCH 40 INSIDE PIPE
8"ø SCH 40 OUTSIDE PIPE
3"ø SCH 40 INSIDE PIPE
2 HOUR FIREMASTER INSULATION ENCLOSURE AROUND BOTH PIPES.
SECTION AA ON DWG M2-01 SIMILAR
N5084.50
N5057.50
N5027.50
N5014.50
FOR TANK ROOM LAYOUT SEE DWG. M1-02
8"ø SCH 40 OUTSIDE PIPE
2" FOS INSIDE PIPE
2" FOR RISER PIPE
2 HOUR FIREMASTER INSULATION ENCLOSURE
SEE DETAIL VERTICAL FUEL OIL SHAFT ON DWG. M2-01
FUEL OIL SITE PLAN
EL. 332'-8"
OVERFILL ALARM BOX MOUNT 6'-8" ABVE SIDEWALK AT PERIMETER WALL
3" BRICK VENT
EL. 319'-0"
B.C. EL. 315'-0"
EL. 315'-0" VESEY STREET
3" FOF 6" ENCLOSURE PIPE
SEE DETAIL M1-04
2 HR RATED ENCLOSURE
1" DRAIN DOWN TO SUMP PAN OFF FOF ENCLOSURE PIPE.
EL. 290'-0"
10,000 GAL F.O. STORAGE TANK
10,000 GAL F.O. STORAGE TANK
SECTION 'A-A'